



Technical Memo

I.F.E.D.A. MEMBERS INFORMATION/TECHNICAL UPDATE


From Ray Griffin.

Date: 30th October 2003.

Number 2

Subject: Unidentified Stored Pressure Water Fire Extinguisher NHS Premises

See attached NHS estates Safety notice

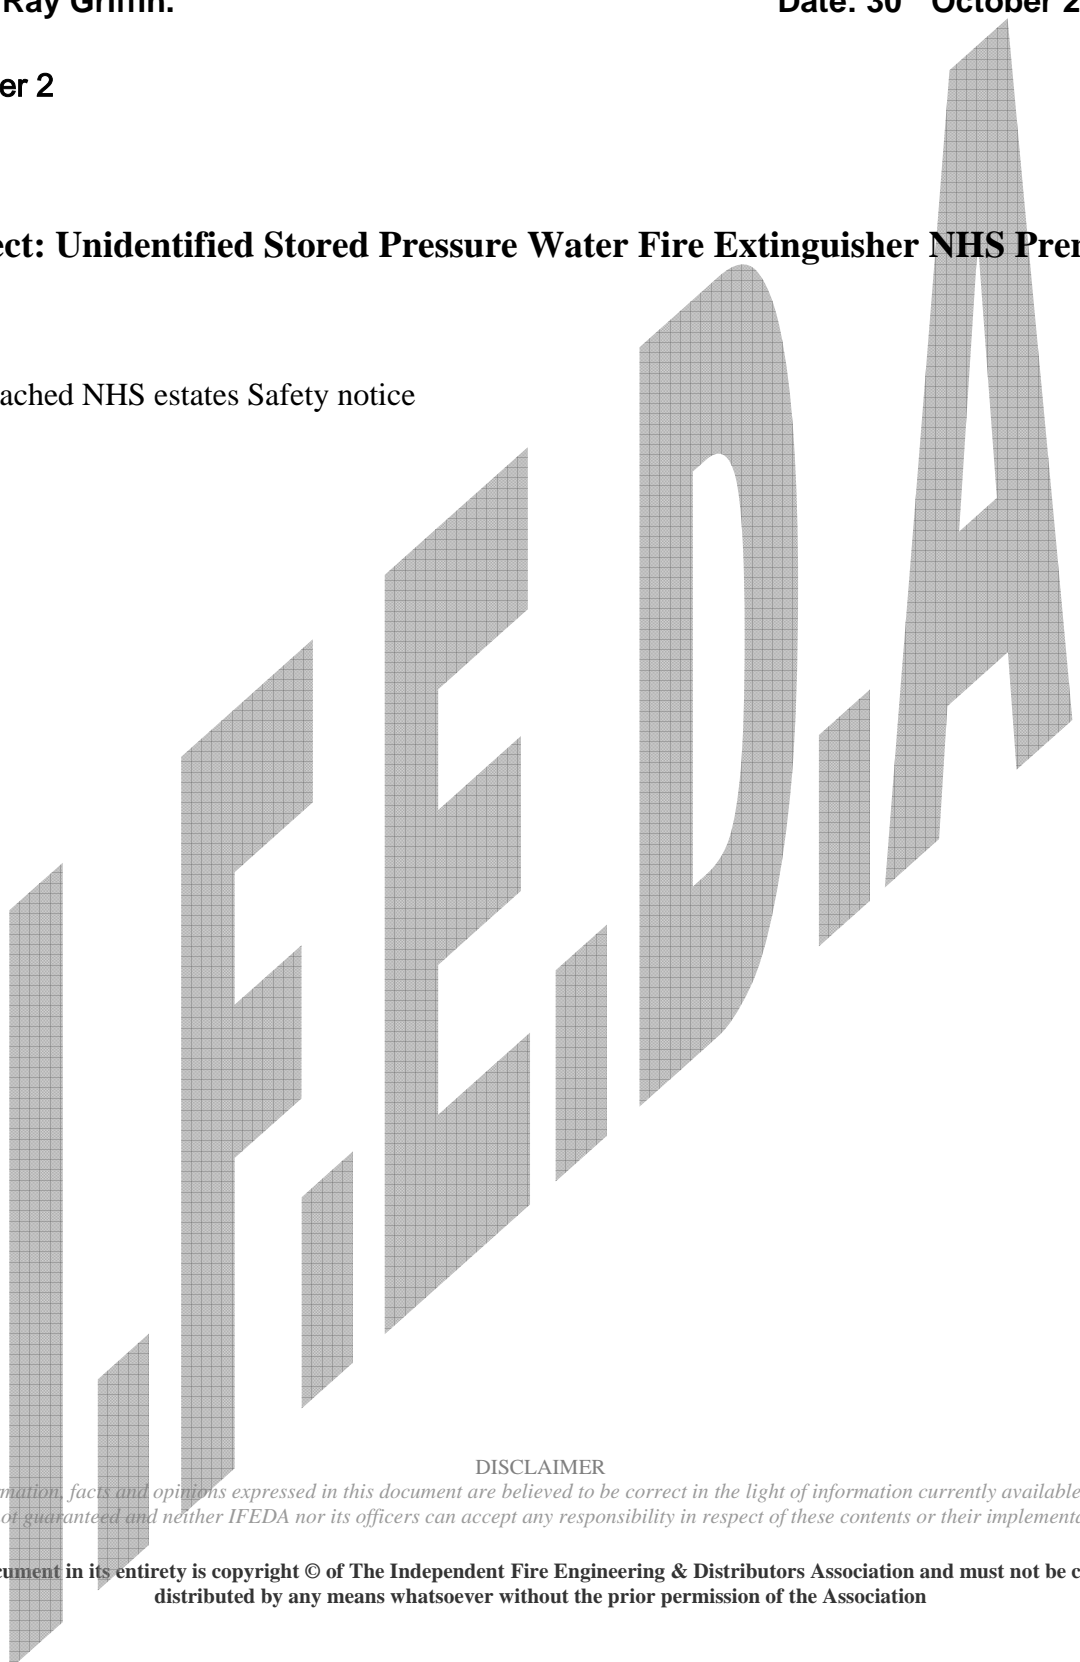

DISCLAIMER

The information, facts and opinions expressed in this document are believed to be correct in the light of information currently available, but they are not guaranteed and neither IFEDA nor its officers can accept any responsibility in respect of these contents or their implementation.

This document in its entirety is copyright © of The Independent Fire Engineering & Distributors Association and must not be copied or distributed by any means whatsoever without the prior permission of the Association